


MINIMUM DRIVEWAY WIDTH - 24 FEET
MAXIMUM DRIVEWAY WIDTH - 36 FEET


#4 EPOXY COATED REINFORCING RODS PLACED 18" ON CENTER IN BOTH DIRECTIONS THROUGH OUT THE SLAB. THEY SHALL BE PLACED TO BE 3" CLEAR OF SLAB EDGES.

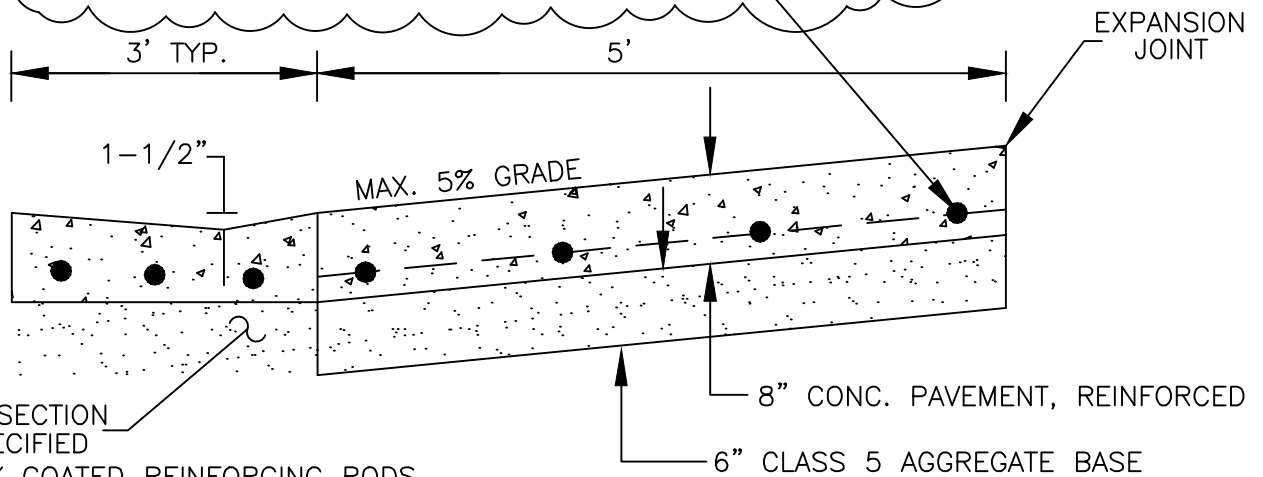

STREET SECTION
AS SPECIFIED

3 #4 EPOXY COATED REINFORCING RODS
CONTINUOUS IN CROSS GUTTER FROM
EXPANSION JOINT TO EXPANSION JOINT.

SECTION A-A

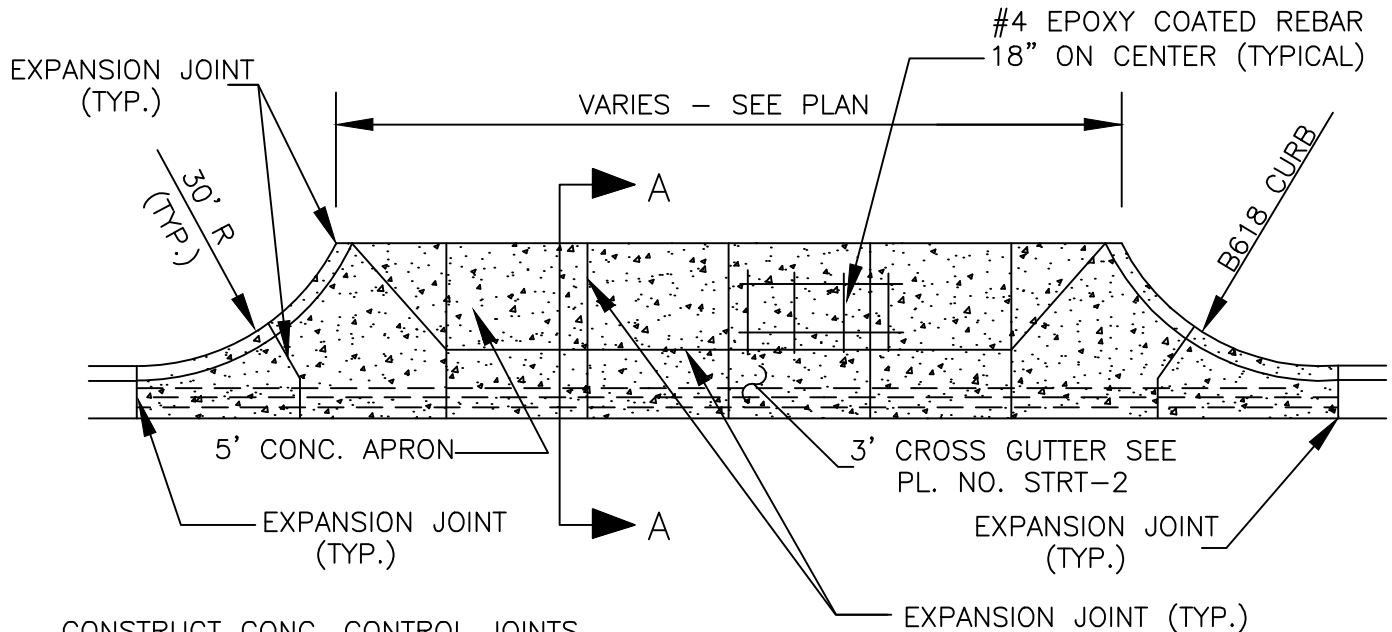

CONSTRUCT CONC. CONTROL JOINTS
SUCH THAT NO PANEL IS GREATER
THAN 100 SQ. FT.

PLAN

SEE PLATES NO. STRT-3 TO 8
FOR PED. CURB RAMPS IF
SIDEWALK OR TRAIL IS
EXISTING OR TO BE
INSTALLED.

NOTE: DRIVEWAY SHALL BE CONSTRUCTED AS
A MONOLITHIC POUR. CURB SHALL NOT BE
RUN THROUGH THE DRIVE BUT STOPPED AT
THE BEGIN AND END RADII.



STANDARD DETAILS
INDUSTRIAL / COMMERCIAL DRIVEWAY
CITY OF PLYMOUTH

PUBLISHED
3-25

CITY PL. NO.
STRT-12
REVISED 3-25