



CONCRETE SLAB 6" MIN. THICKNESS, REINFORCED WITH #4 EPOXY COATED REINFORCING RODS PLACED 18" ON CENTER IN BOTH DIRECTIONS THROUGH OUT THE SLAB. THEY SHALL BE PLACED TO BE 3" CLEAR OF SLAB EDGES. SLAB SHALL BE PLACED ON 6" OF COMPACTED CL 5 AGGREGATE BASE.

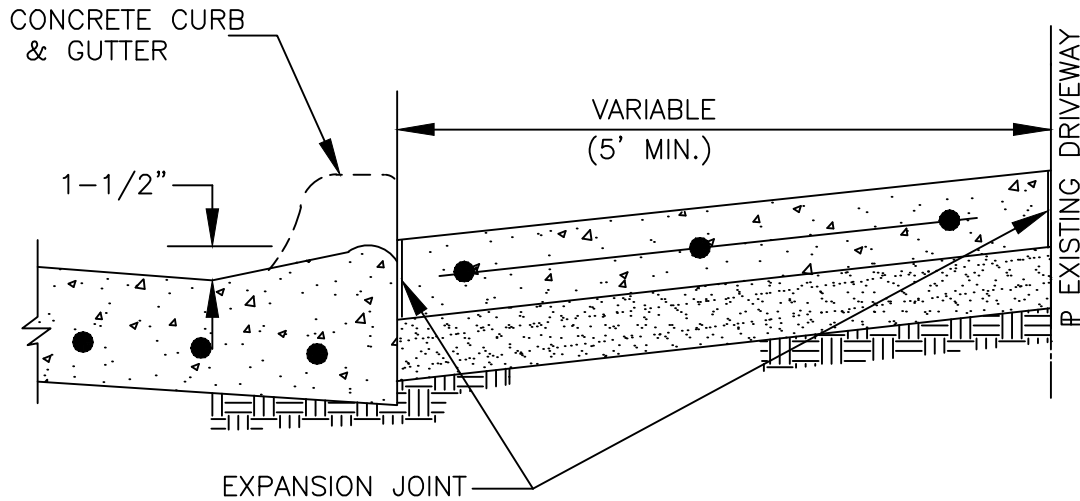


SECTION A-A

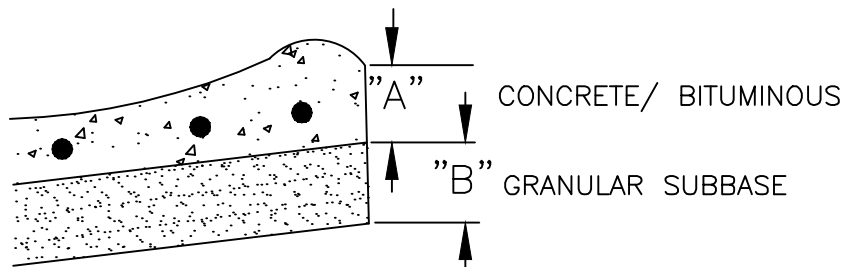

SECTION B-B

	CONCRETE	BITUMINOUS
"A"	6"	3"
"B"	6"	6"
"C"	3'	3'

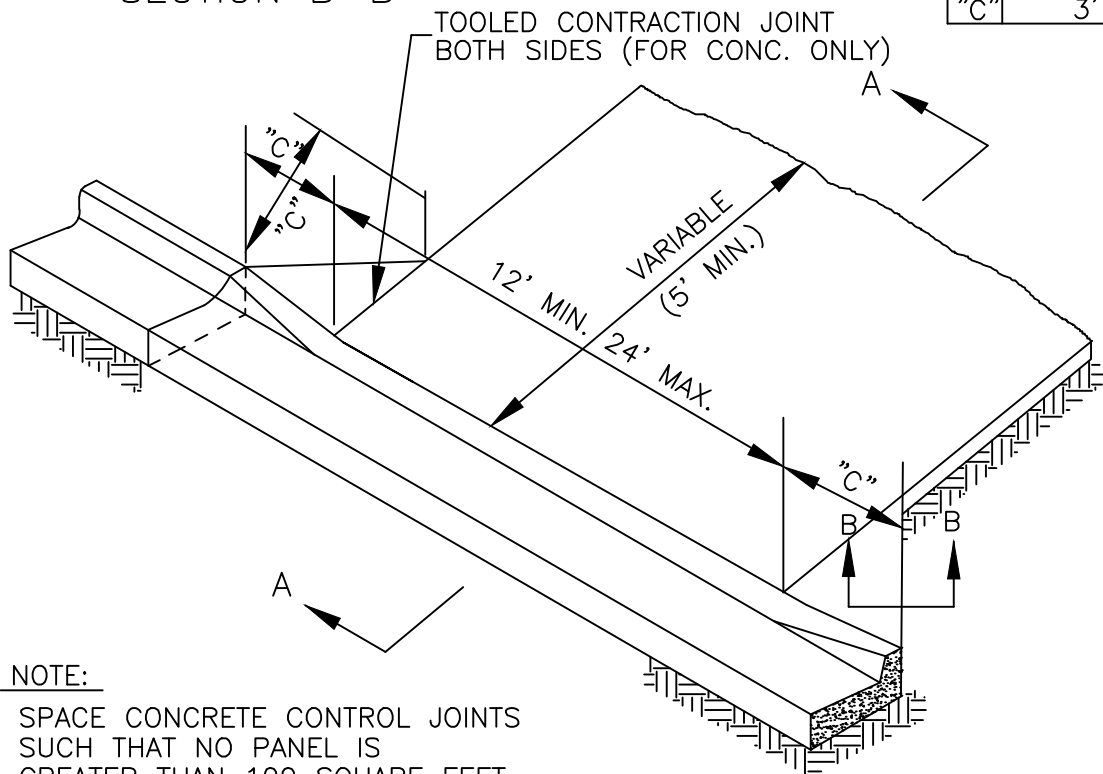

NOTE:

SPACE CONCRETE CONTROL JOINTS SUCH THAT NO PANEL IS GREATER THAN 100 SQUARE FEET. MATCH JOINTS TO EXISTING DRIVEWAY WHERE FEASIBLE



STANDARD DETAILS
RESIDENTIAL DRIVEWAY DETAIL
CITY OF PLYMOUTH

PUBLISHED
3-25

CITY PL. NO.
STRT-13
REVISED 3-25