


USE THIS BLOW OFF ASSEMBLY AT THE DEAD
END OF A WATERMAIN IN LIEU OF A HYDRANT
INSTALLATION.



PER WATERMAIN SPECIFICATION 02205.13 WATERMAIN STUBS PRESSURE RELIEVE PROVISION

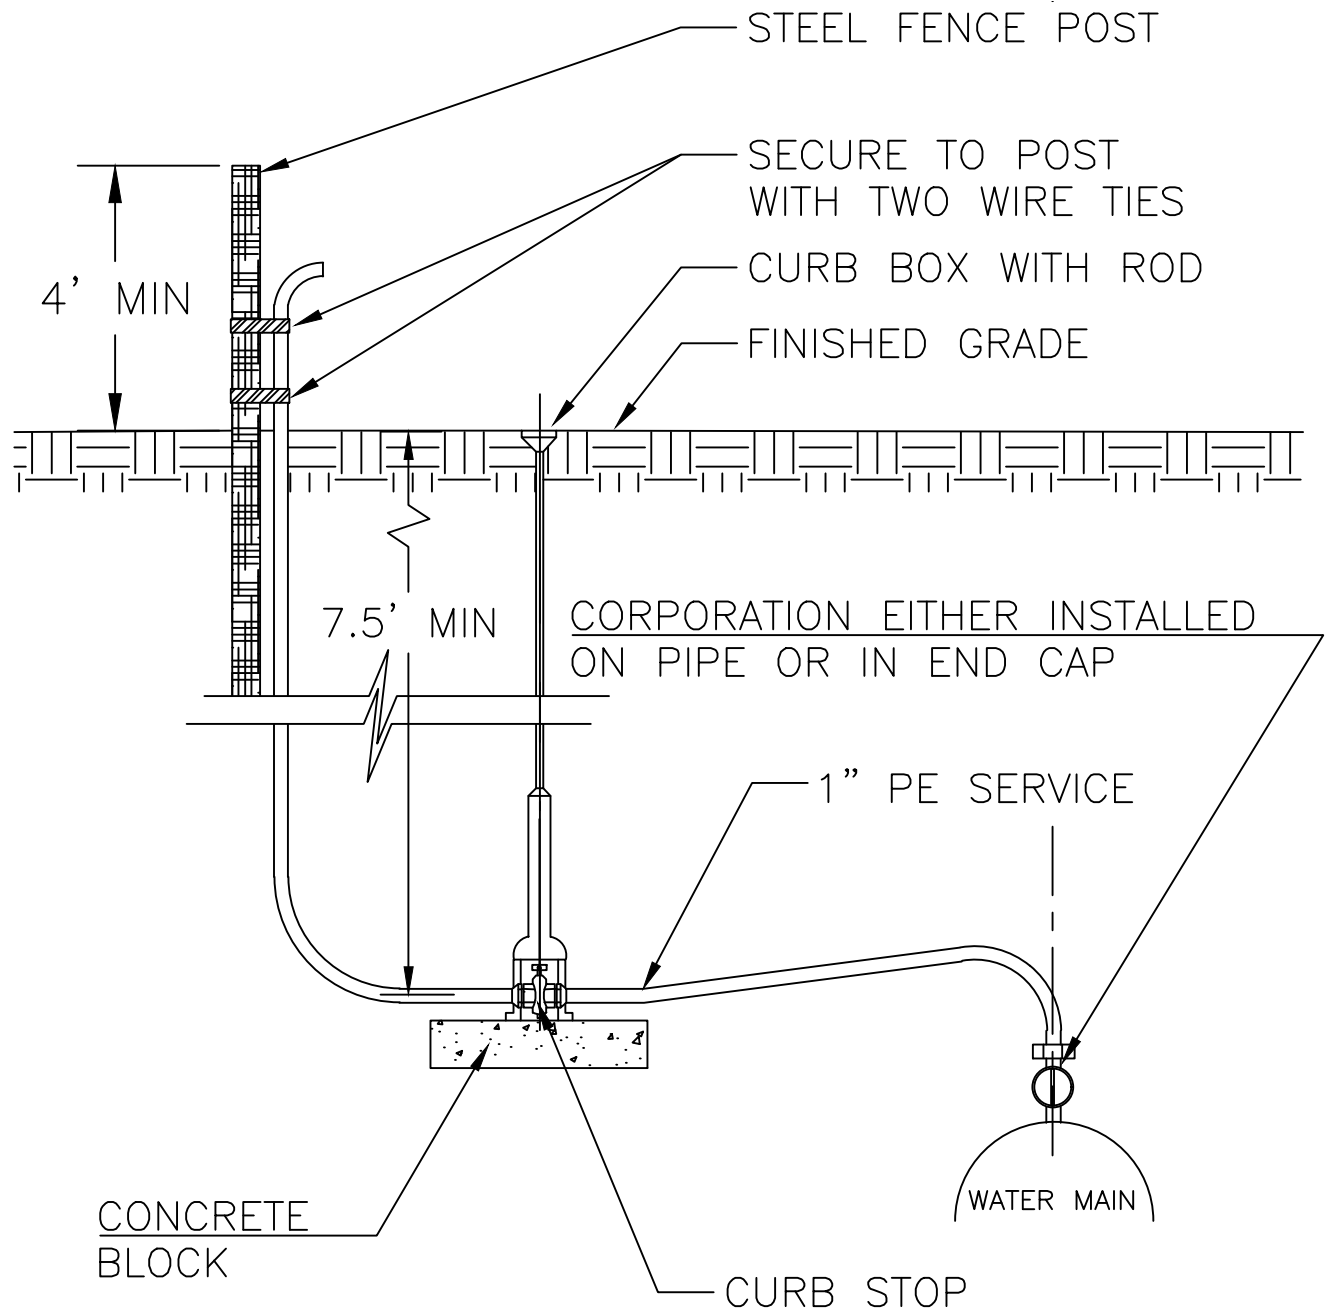

STANDARD DETAILS
WATER MAIN STUB BLOW OFF DETAIL
CITY OF PLYMOUTH

PUBLISHED
3-25

CITY PL. NO.
W-7
REVISED 1-19